




INDUSTRIAL SIMPLEX

Conference System.

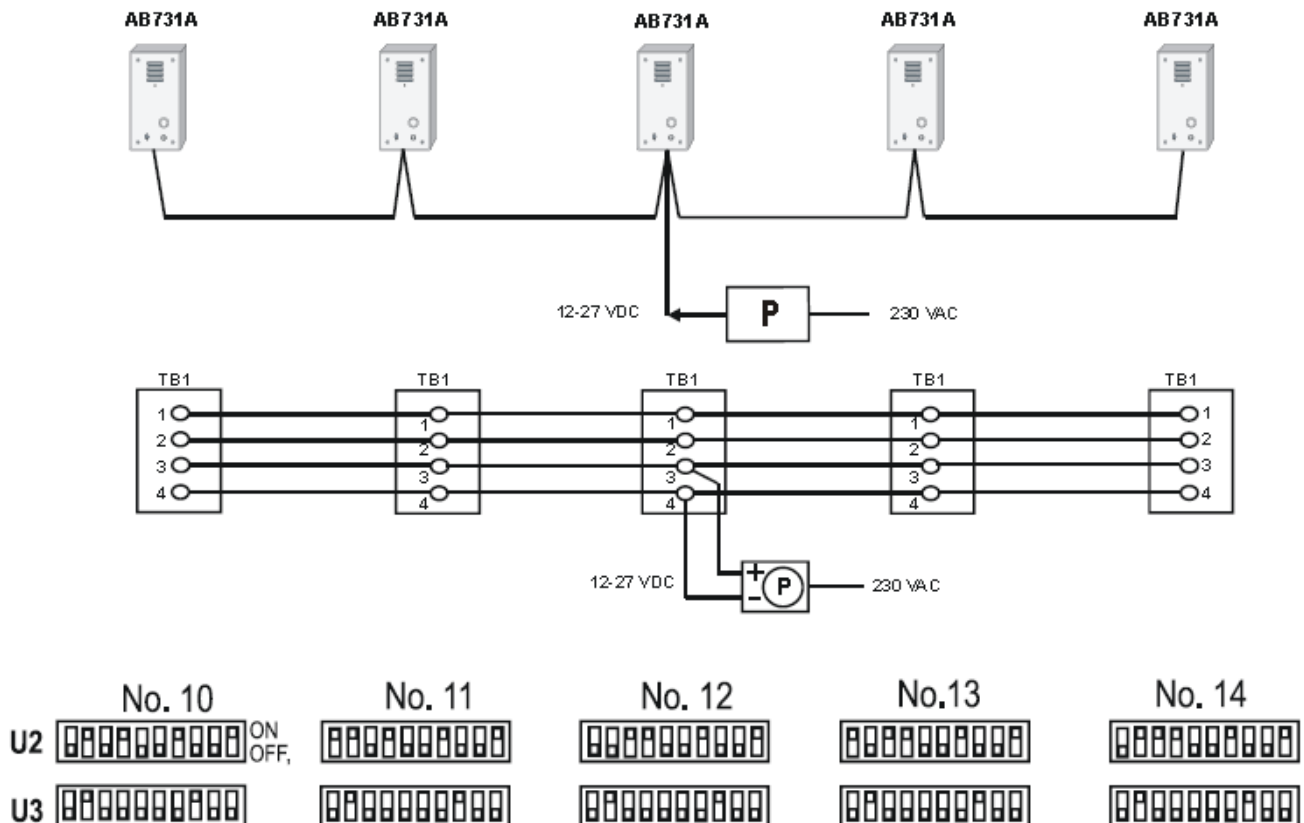

Description

P: Power supply. Should be located as close to the centre of the installation as possible.

All stations are programmed as direct dialling 10 keys stations.

All stations can make an emergency call by pressing button no. 9 (call button).

All stations can receive emergency call.

Anyone can press the call button and give a message to the other stations while keeping the call button pressed.

The call is cancelled automatically when the call button is released